

FIG.2


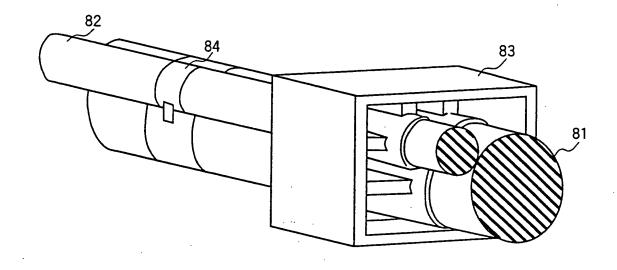


FIG.7

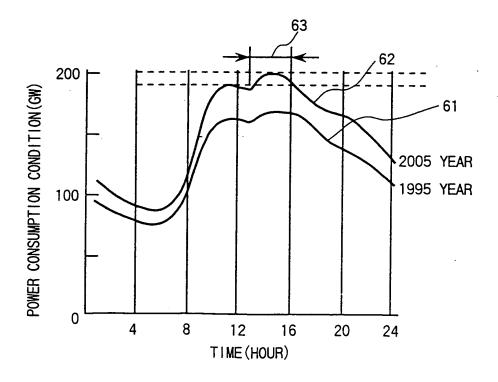

3 / 13

FIG.3

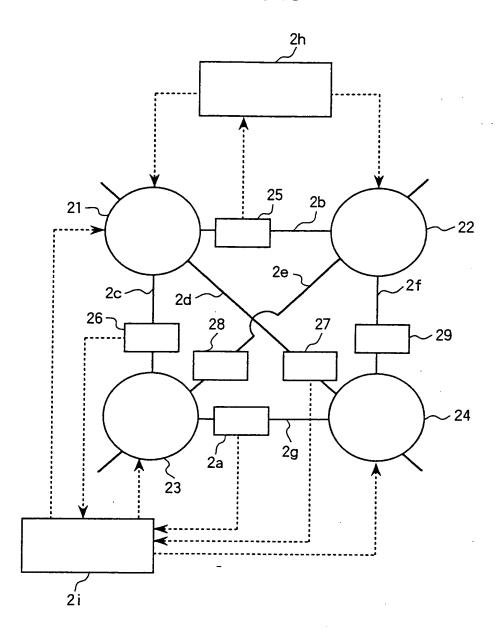
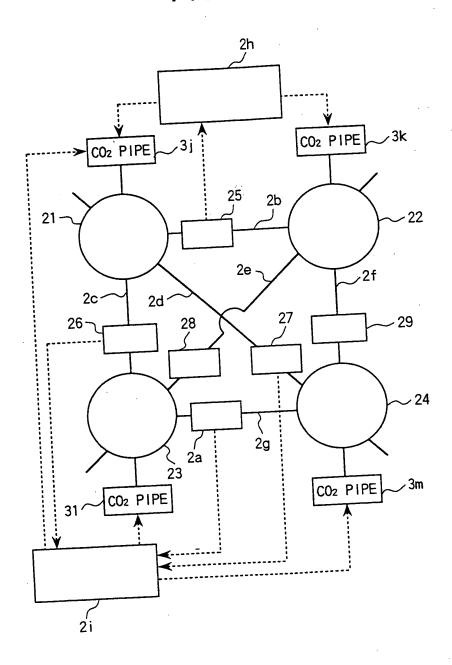


FIG.4



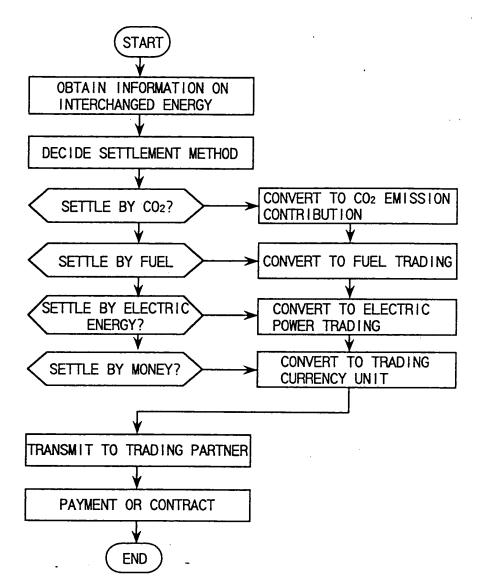
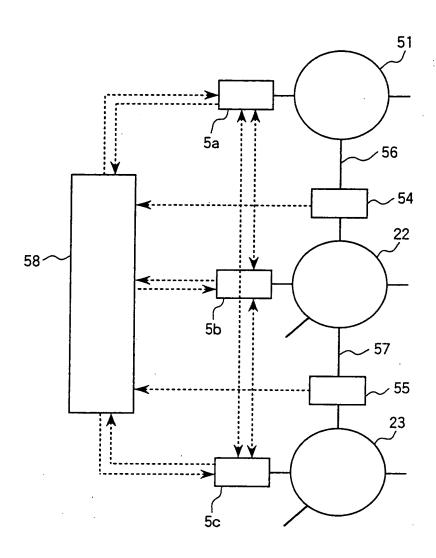
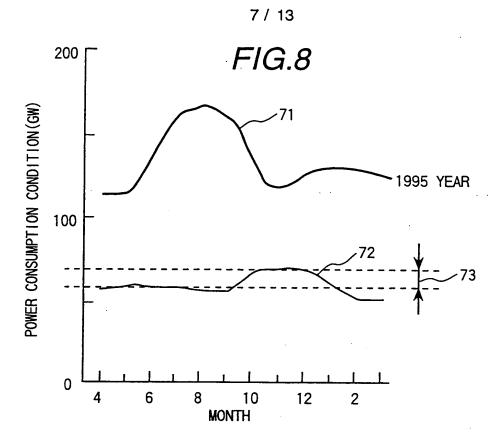


FIG.6





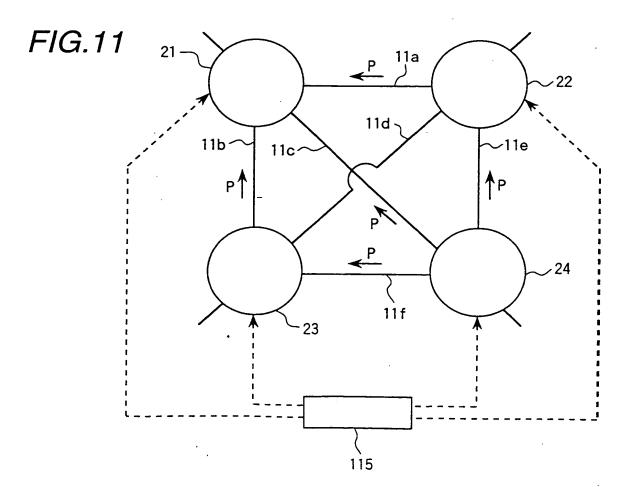
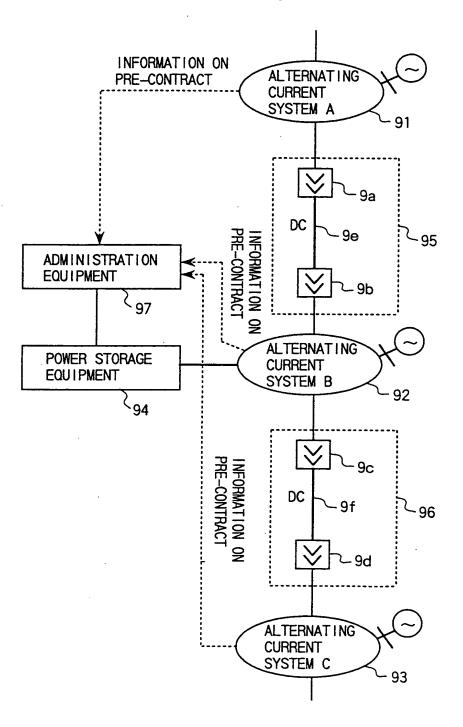
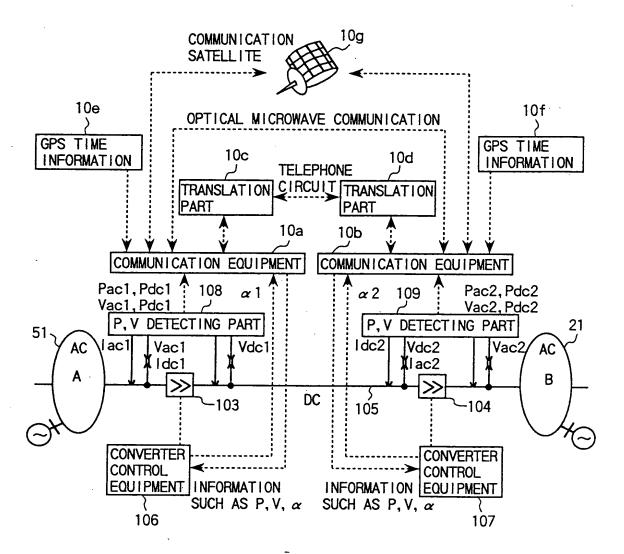
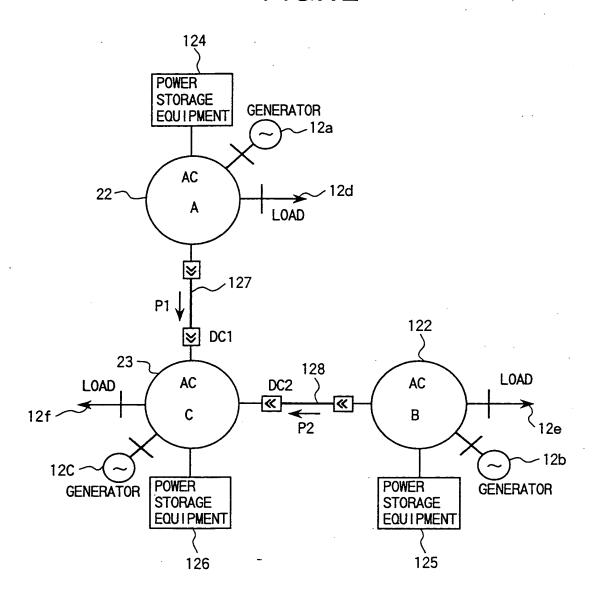


FIG.9







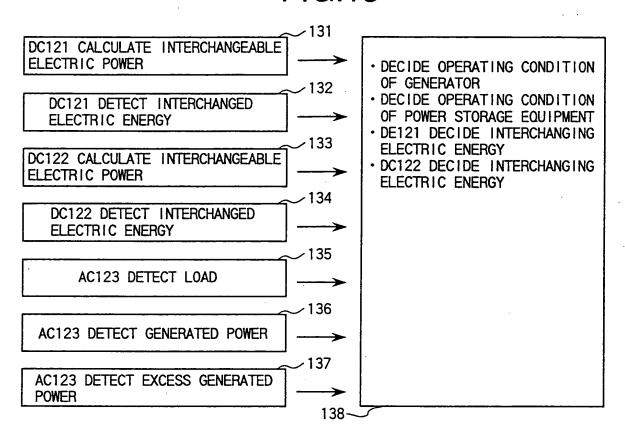


FIG.14 141 144 EXCAHNGE RATE INFORMATION 142 CHANGE DIRECT CARRY OUT POWER **CURRENT** MINIMIZATION GENERATION COST INTERCONNECTION CALCULATION OF INFORMATION POWER COMMAND POWER COST 143 VALUE POWER TRANSMISSION ROUTE INFORMATION 145

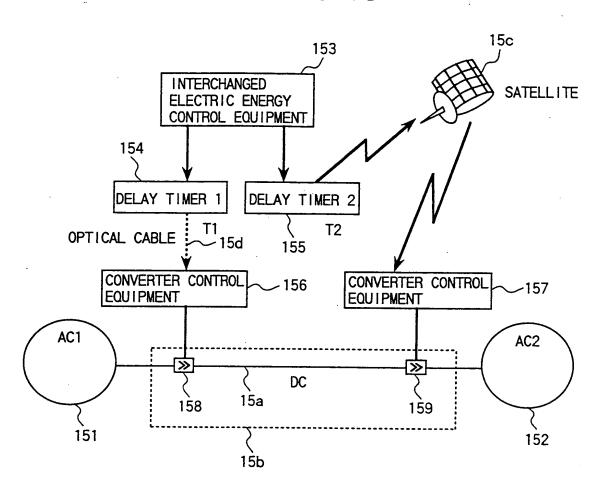


FIG.16

